kamstrup

Data sheet

OMNIPOWER CT

- Current transformer meter
- Apparent power values per phase and total (KVA, PF)
- Power Quality Measurements according to EN 50160
- Optimized for Smart Metering systems
- · Secured against tampering
- Resistant to errors in the supply network
- Ultra-low power consumption
- Built-in radio communication
- Transformer ratio up to 3000A/5A or 600A/1A
- Type approved according to:
 - Active energy
 EN 50470-1 (MID)
 EN 50470-3 (MID)
 - Active energy and reactive energy IEC 62052-11 IEC 62053-22 IEC 62053-23
- Communication protocol:
 - DLMS/COSEM
 - EN 62056-21 Mode A,C and DO



Content

| Application | 3 |
|---|----|
| Functions | 4 |
| Approvals | 8 |
| Technical data | 8 |
| Connections | 9 |
| Communication | 10 |
| Consumer communication channel (CCC) module | 10 |
| Transformer ratio | 10 |
| Typical accuracy charts (In = 5A) | 11 |
| Configuration - hardware | 12 |
| Configuration - software | 13 |
| Installation | 18 |
| Connection diagrams | 18 |
| Safety and installation guidelines | 18 |
| Dimensions | 19 |
| Accessories | 20 |

Application

OMNIPOWER CT is a 3-phased current transformer electricity meter for registration of electric energy. The meter is fully electronic without movable parts. Thus, energy registration is not affected by shock or impact during transport and mounting. Furthermore, measurements are correct no matter the physical mounting direction.

Energy is determined by simultaneously measuring voltage and current. The current is measured via current transformers.

The easily readable display scrolls automatically between readings, or readings can be changed manually by activating the left push button. The required display readings as well as their order are configurable.

In addition to being read from the display, data can be collected via Radio Mesh network, optical output or from the module area. The unique module area also permits external changing of tariffs, pulse inputs and outputs, and configuration as well as a wide range of communication media.

A Consumer Communication Channel is available for data exchange with Smart Home products.

From the factory, the meter can be configured to measure both imported and exported energy. The meter makes accurate measurements whether it measures 1, 2 or 3 phases. Measurements are saved in a permanent memory.

As default, the OMNIPOWER CT meter can generate load profiles in all four quadrants.

A load profile provides detailed information about consumed and produced energy. An additional logger with 16 channels contains data for analysis purposes.


The OMNIPOWER CT meter is also designed to support extended analysis of the main grid using measurements of THD (voltage), Power Factor, Voltage unbalance, Voltage variations and sags and swells.

In order to minimise the manual configuration during installation, the meter is preconfigured from the factory. Furthermore, the meter can be reconfigured via a Smart Metering system.

Display

OMNIPOWER CT is provided with a Liquid Crystal Display (LCD). The registers that can be read from the display depend on the chosen configuration. It is also possible to remotely configure the display.

The display configuration is constructed as three independent display lists: One for automatic shift function, one for manual shift function and one for back-up-powered shift function. The display is constructed of segments as shown in the figure below.

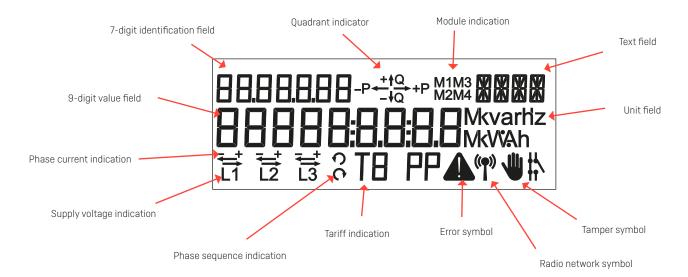

9-digit value field: This field is used for displaying register values.

Unit field: This field is used for displaying the units that are related to the value field.

7-digit identification field: OBIS code identification of the value in the value field.

Ouadrant indicator: Indicates the current load type.

Text field: Contains additional text in connection with the meter's function.

Module indication: Indicates if and which modules that communicate in the display.

Error symbol: Indicates critical internal errors.

Tamper symbol: Indicates magnetic influence or opening of the meter cover, either temporary or permanent.

Radio Network symbol: Indicates communication with AMR system.

Tariff indication: Indicates the current tariff if tariffs have been selected.

Phase sequence indication: Indicates the phase sequence of the input phases.

← = L1L2L3 ← = L1L3L2

Supply voltage indicator: Indicates that voltage is above the minimum threshold (160 V). Phase current indication: Indicates that the load is above the minimum threshold (0,6 W).

Display

The automatic shift function (scroll) changes between the selected readings every 10 seconds. Historical data cannot be selected in the automatic shift function. Up to 16 readings can be selected.

The manual shift function changes through activation of the left push button. Up to 30 readings and the reading order can be selected. However, it is not possible to deselect the legal readings.

If the back-up-operated shift function is selected, it becomes possible to read the display, also when the meter is not power supplied. Up to 8 readings can be selected, and shifts between readings are made by activating the left push button.

The meter automatically returns from manual shift function to automatic scroll function two minutes after the last activation of the left push button.

Energy reading

OMNIPOWER CT has one current transformer per measuring system and resistance division for voltage measurement.

Energy consumption is calculated as an expression of the current compared to the phase voltage and time.

The energy registration per measuring system is communicated to the meter's legal processor via the meter's own internal bus system and is summed in the meter's main registers.

Permanent memory

Measured and calculated data are stored in the meter's permanent memory. Data are stored by every change of energy register values.

Furthermore, the below mentioned values are stored at the end of a debiting period:

| Various | Energy registers | Power registers |
|------------------------------|--|---|
| RTC/Quality info | Active positive primary energy A+ | Peak power P+max |
| Hour counter | Active negative primary energy A- | Peak power P+ max RTC |
| Debiting stop counter | Reactive positive primary energy R+ | Accumulated peak power P+max acc |
| Power threshold counter (A+) | Reactive negative primary energy R- | Accumulated peak power P+max acc Tariff 1 |
| Pulse input | Apparent positive energy E+ | Accumulated peak power P+max acc Tariff 2 |
| Current transformer ratio | Apparent negative energy E- | Peak power Q+max |
| | Active positive primary energy A+ Tariff 1 | Peak power Q+ max RTC |
| | Active positive primary energy A+ Tariff 2 | Accumulated peak power Q+max acc |
| | Active positive primary energy A+ Tariff 3 | Peak power P+max Tariff 1 |
| | Active positive primary energy A+ Tariff 4 | Peak power P+ max Tariff 1 RTC |
| | Reactive positive primary energy R+ Tariff 1 | Peak power P+max Tariff 2 |
| | Reactive positive primary energy R+ Tariff 2 | Peak power P+ max Tariff 2 RTC |
| | Reactive positive primary energy R+ Tariff 3 | Peak power Q+max Tariff 1 |
| | Reactive positive primary energy R+ Tariff 4 | Peak power Q+ max Tariff 1 RTC |
| | | Peak power Q+max Tariff 2 |
| | | Peak power Q+ max Tariff 2 RTC |
| | | Peak power S+max |
| | | Peak power S+ max RTC |
| | | Peak power S-max |
| | | Peak power S- max RTC |

Plug-in modules

OMIPOWER CT can be mounted/retrofitted with plug-in modules without subsequent reverification.

The module communicates with the meter's microprocessor via an internal data bus. This provides innumerable functional possibilities such as extra pulse output, tariff, load control and data communication via e.g. GSM/GPRS and M-Bus.

Optical reading

An optical sender/receiver is placed on the front of the meter. This optical connection can be used to read data or configure e.g. display set-up, meter number and other settings.

Changes via the optical connection can be made by using the software program METERTOOL OMNIPOWER.

It is not possible to change the meter's legal data.

SO pulse output

Emits pulses of secondary active energy at 5000 pulses per kWh. The maximum voltage, which may be connected to the S0 output, is 27 V DC (at $1\,\mathrm{k}\Omega$), and the maximum current, which can be drawn through the output, is 27 mA. The pulse time is 30 msec.

Load profile*

Load profiles can be configured to 15, 30 or 60 min. according to the integration period and for all four quadrants. The number of generated profiles corresponds to the selected energy type for the meter.

| Integration period | 15 min. | 30 min. | 60 min. |
|--------------------|---------|---------|---------|
| Energy type | days | days | days |
| A+ | 275 | 550 | 1100 |
| A+/A- | 231 | 462 | 924 |
| A+/R+ | 231 | 462 | 924 |
| A+/A-/R+/R- | 175 | 350 | 700 |

^{*} Load profile for Austria is limited to 60 days with a fixed integration period of 15 min

Analysis logger

OMNIPOWER CT is provided with a configurable analysis logger. The logging depth is depending on the configuration of the meter as well as the number of registers. The analysis logger can register data from up to 16 different registers at a time. OMNIPOWER CT is available with default setting which can be reconfigured subsequently via METERTOOL OMNIPOWER or a Smart Metering system.

Tamper proof

Apart from the mechanical sealing, the meter also reveals tampering (including opening of the meter cover). In case of attempts of tampering (mechanical or magnetic), an alarm is activated which is time and date stamped and saved to the permanent memory. Alarms can be automatically transferred via the communication infrastructure and, indicated on the display.

Power quality measurments

The OMNIPOWER CT meter is also designed to support extended analysis of the main grid using measurements of the THD (voltage), Power Factor, Voltage unbalance, Voltage variations and sags and swells.

Approvals

OMNIPOWER CT is type approved according to the Measuring Instruments Directive (MID) for active energy and according to the national requirements for other energy types, where required.

| Approval | Norm |
|-------------------------------------|--------------|
| Type test according to: | |
| - Active energy | EN 50470-1 |
| | EN 50470-3 |
| – Reactive energy and active energy | IEC 62052-11 |
| <i>G,</i> | IEC 62053-22 |
| | IEC 62053-23 |
| | |

| Various | Norm |
|-------------------|--------------|
| Terminal | DIN 43857 |
| S0 pulse output | DIN 43864 |
| Optical reading | EN 62056-21 |
| OBIS/EDIS codes | IEC 62056-61 |
| Interface classes | IEC 62056-62 |
| Data link layer | IEC 62056-72 |

Technical data

Measuring principle

 $\begin{array}{lll} - \mbox{ Current} & \mbox{ Single-phased current measurements via current transformers} \\ - \mbox{ Voltage} & \mbox{ Single-phased voltage measurements by voltage divider} \\ \mbox{ Nominal voltage U}_n & \mbox{ 3 x 230 VAC -20 \% ... +15 \% (for Aron meter only)} \end{array}$

3 x 230/400 VAC -20 % - +15 %

| Current | | |
|---------|-------|--|
| | X_5 | I _{min} - I _n (Imax) |
| | 1 | 0,01 - 1(6) A |
| | 5 | 0,05 - 5(6) A |

Accuracy class Class 1 (IEC) / Class B (MID) Class 0,5 (IEC) / Class C (MID) Reactive energy: class 2 (IEC) Nominal frequency f_n 50 Hz \pm 5 % or 60 Hz \pm 5 %

Phase displacement Unlimited (however, not for Aron meters)

Operating temperature $-40 \, ^{\circ}\text{C} - +70 \, ^{\circ}\text{C}$ Storage temperature $-40 \, ^{\circ}\text{C} - +85 \, ^{\circ}\text{C}$

Technical data

Protection class IP54
Protection class II

Relative humidity < 75 % year's average at 21 °C

< 95 % less than 30 days/year, at 25 °C

Weight 0.90 kg

Application area Indoors or outdoors in suitable meter cabinet

Internal consumption*

| Maximum power consumption of the current circuits with basic current | 0.02 VA |
|--|-----------------|
| Maximum power consumption of the voltage circuits | 0.2 VA 0.1 W |

^{*} Measured by notified body during type test. Measured at phase L1

Materials Glass reinforced polycarbonate

Data storage Permanent memory, > 10 years without voltage

Display LCD, 7 mm digit height (value field)

LCD, 5 mm digit height (OBIS-field, Text-field and Tariff readings)

LCD, 3 mm digit height (voltage and power readings)

Meter constant 10000 imp/kWh

S0 pulse diode 10000 imp/kWh, kvarh

Pulse time 30 ms \pm 10 %

SO pulse output 5000 imp/kWh

Pulse time 30 ms ± 10 %

Real Time Clock (RTC)

Accuracy Typically 5 ppm at 23 °C

Backup Battery life > 10 years at 23 °C

Supercap life > 10 years at 23 °C

Supercap operating time 7 days fully charged

Connections

Main terminals

Voltage output

Size 2.5 – 10 mm² elevating connections

Screws Ph2 or (4x1) straight slot Torque 1,8 Nm +/- 10%

0.25 - 1.5 mm², 5 mm cable terminal forks

 Screws
 TORX Tx 10

 Torque
 1.0 Nm +/- 10 %

Communication

OMNIPOWER CT can be supplied and retrofitted with communication modules. The modules function as inputs and outputs for the meter. Mounting of modules does not require subsequent verification of the meter.

Communication Modules

So supply Sends 24 V via a 2-wire and pulses by drawing the voltage to 0 V at each pulse. Can

supply e.g. MULTICAL®.

Serial RS-485 or RS-232 communication or current loop with pulse inputs, tariff

inputs or load control.

M-Bus Reading via wired M-Bus system.

TCP/IP Collection of consumption data via TCP/IP communication.

GSM/GPRS Collection of consumption data via GSM/GPRS communication. Supports SMS

reading.

Integrated radio

OMNIPOWER CT can be provided with built-in radio communication for Kamstrup Radio Mesh Network.

Radio communication therefore requires no mounting/retrofitting of communication module. If the meter's module area is used for another type of communication, the built-in radio communication can be deactivated.

Consumer communication channel (CCC) module

In OMNIPOWER CT it is possible to mount a CCC- (Consumer Communication Channel) module. The module can be used for communication and data exchange with Smart Home products such as energy displays and external relays. The CCC-module is mounted without using tools or breaking the seal of the meter. The mounting may be done by e.g. the consumer himself.

Transformer ratio


The transformer ratio in the OMNIPOWER CT can be configured depending on the current transformer installed with the meter.


The ratio can be configured from 1 to 600 without reverifying the meter.


The primary energy is displayed in the display when entering the transformer ratio of the current transformer. The secondary energy reading always indicates the total consumption for the energy types chosen.


Changes in the ratio are stored in the permanent memory of the meter.


Typical accuracy charts (In = 5A)

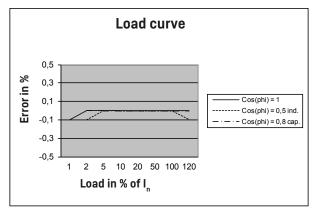

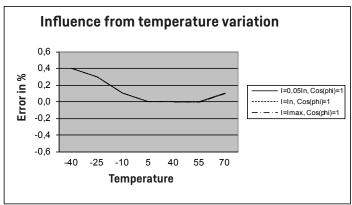

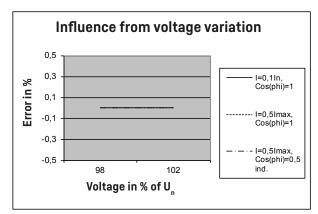

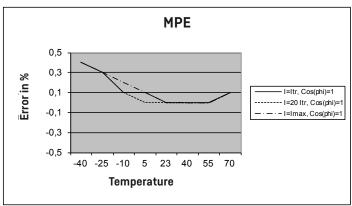

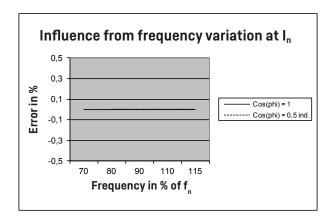


MPE (Maximum Permissible Error)

Error composed of:

- · current load
- · voltage variation
- · frequency variation
- temperature variation

Configuration - hardware

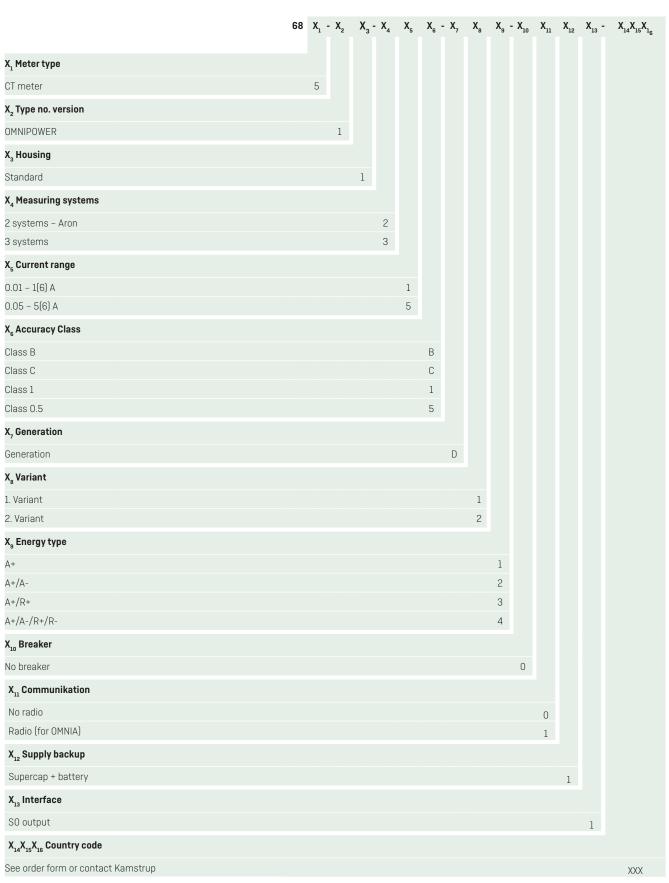

| | | | Z1 | Z2 | Z 3 | Z 4 |
|---|--------|--------|----|----|------------|------------|
| 71 Desimals in display | | | | | | |
| Z1 Decimals in display | | | , | | | |
| 7.0 (Default) | | | 1 | | | |
| 7.1 (Country specific) | | | 2 | | | |
| 7.2 (Country specific) | | | 3 | | | |
| Z2 LED configuration | | | | | | |
| LED switched off without consumption | | | | 1 | | |
| LED switched on without consumption | | | | 2 | | |
| Z3 Primary module configuration | 1/01 | 1/0 2 | | | | |
| No function | - | - | | | 00 | |
| 4-tariff | Input | Input | | | 01 | |
| 4-tariff inverted | Input | Input | | | 02 | |
| Pulse in / Alarm in | Input | Input | | | 03 | |
| Pulse in / Alarm in inverted | Input | Input | | | 04 | |
| Pulse in / A+ out | Input | Output | | | 05 | |
| R+ out / A+ out | Output | Output | | | 06 | |
| 2-tariff / Alarm in | Input | Input | | | 07 | |
| 2-tariff inverted / Alarm in | Input | Input | | | 08 | |
| 2-tariff / Alarm in inverted | Input | Input | | | 09 | |
| 2-tariff inverted / Alarm in inverted | Input | Input | | | 10 | |
| 2-tariff / A+ out | Input | Output | | | 11 | |
| 2-tariff inverted / A+ out | Input | Output | | | 12 | |
| Pulse in / 2-tariff | Input | Input | | | 13 | |
| Pulse in / 2-tariff inverted | Input | Input | | | 14 | |
| Debiting stop pulse / - | Input | - | | | 15 | |
| A- out / A+ out | Output | Output | | | 16 | |
| Load control load / Status control | Input | Output | | | 17 | |
| Pulse in / Load tariff sync | Input | Output | | | 18 | |
| Pulse in inv. / Load tariff sync | Input | Output | | | 19 | |
| Pulse in / Load tariff sync inverted | Input | Output | | | 20 | |
| Pulse in inv. / Load tariff sync inverted | Input | Output | | | 21 | |
| 4-tariff sync load control | Input | Input | | | 22 | |
| 4-tariff sync load control inverted | Input | Input | | | 23 | |
| Load control 1 / Load control 2 | Output | Output | | | 26 | |
| Pulse in / Load control | Input | Output | | | 27 | |
| Pulse in / Toggle Load control 1 & 2 | Input | Output | | | 28 | |
| Z4 Integration period / Load profile period | | | | | | |
| 15 min. | | | | | | 2 |
| 30 min. | | | | | | 3 |
| 60 min. | | | | | | 4 |

| | Z 5 | Z6 | | Z7 |
|--|------------|----|--|----|
| Z5 Display configuration | | | 77 Dehiting logging interval | |
| See display order form or contact Kamstrup | | | Z7 Debiting logging interval None (externally controlled) | 00 |
| | | | Monthly | 01 |
| Z6 Debiting stop date | | | Every second month, January | 02 |
| 1 | | 01 | Every second month, February | 03 |
| 2 | | 02 | Every third month, January | 0. |
| 3 | | 03 | Every third month, February | 0. |
| 4 | | 04 | Every third month, March | 0. |
| 5 | | 05 | | 0 |
| 6 | | 06 | Half-yearly, January | 0: |
| 7 | | 07 | Half-yearly, February | 0 |
| 8 | | 80 | Half-yearly, March | |
| 9 | | 09 | Half-yearly, April | 1 |
| 10 | | 10 | Half-yearly, May | 1 |
| 11 | | 11 | Half-yearly, June | 1 |
| 12 | | 12 | Yearly, January | 1 |
| 13 | | 13 | Yearly, February | 1 |
| 14 | | 14 | Yearly, March | 1 |
| 15 | | 15 | Yearly, April | 1 |
| 16 | | 16 | Yearly, May | 1 |
| 17 | | 17 | Yearly, June | 1 |
| 18 | | 18 | Yearly, July | 1 |
| 19 | | 19 | Yearly, August | 2 |
| 20 | | 20 | Yearly, September | 2 |
| 21 | | 21 | Yearly, October | 2 |
| 22 | | 22 | Yearly, November | 2 |
| 23 | | 23 | Yearly, December | 2 |
| 24 | | 24 | Z8 Pulse out length / Alarm input | |
| 25 | | 25 | 30 msec pulse length / Alarm input deactivated | |
| 26 | | 26 | 30 msec pulse length / Alarm input active | |
| 27 | | 27 | 80 msec pulse length / Alarm input deactivated | |
| 28 | | 28 | 80 msec pulse length / Alarm input active | |

Z8

| | | Z10 | Z11 | Z12 |
|-------------------------------|------------------------------|-----|-----|------------|
| Z10 Analysis logger setup | | | | |
| Default setup | | 000 | | |
| Z11 Greenwich Mean Time (GMT) | | | | |
| 0 | GMT | | 00 | |
| 1 | + 1 Hour (DK/NO/SE/DE/FR/ES) | | 01 | |
| 2 | + 2 Hours [FI] | | 02 | |
| 3 | + 3 Hours | | 03 | |
| 4 | + 4 Hours | | 04 | |
| 5 | + 5 Hours | | 05 | |
| 6 | + 6 Hours | | 06 | |
| 7 | + 7 Hours | | 07 | |
| 8 | + 8 Hours | | 08 | |
| 9 | + 9 Hours | | 09 | |
| 10 | + 10 Hours | | 10 | |
| 11 | + 11 Hours | | 11 | |
| 12 | + 12 Hours | | 12 | |
| -11 | - 11 Hours | | 13 | |
| -10 | - 10 Hours | | 14 | |
| -9 | - 9 Hours | | 15 | |
| -8 | - 8 Hours | | 16 | |
| -7 | - 7 Hours | | 17 | |
| -6 | - 6 Hours | | 18 | |
| -5 | - 5 Hours | | 19 | |
| -4 | - 4 Hours | | 20 | |
| -3 | - 3 Hours | | 21 | |
| -2 | - 2 Hours | | 22 | |
| -1 | - 1 Hours | | 23 | |
| Z12 Unit pulse input | | | | |
| None | | | | 00 |
| kWh | | | | 01 |
| m³ | | | | 02 |
| L | | | | 03 |

| | Z13 | Z14 | Z15 | Z16 | Z17 | Z18 | |
|--|-----|------------|-----|-----|-----|-----|--|
| Z13 Tariff control plan | | | | | | | |
| See tariff order form or contact Kamstrup | _ | | | | | | |
| Tariff disabled | 000 | | | | | | |
| Module Port control | 001 | | | | | | |
| Register control | 002 | | | | | | |
| Z14 Load control plan | | | | | | | |
| See load control order form or contact Kamstrup | | - | | | | | |
| Load control disabled | | 000 001 | | | | | |
| Register control | | 001 | | | | | |
| Z15 Daylight Saving time / Summer-winter time table None | | | 000 | | | | |
| EU | | | 001 | | | | |
| | | | 001 | | | | |
| Z16 Frequency code Protocol | | | | | | | |
| None | | | | 000 | | | |
| CH 318 K | | | | 318 | | | |
| EU 319 K | | | | 319 | | | |
| SE 326 K | | | | 326 | | | |
| SE 328 K | | | | 328 | | | |
| SE 329 K | | | | 329 | | | |
| NO 337 K | | | | 337 | | | |
| NO 338 K | | | | 338 | | | |
| NO 339 K | | | | 339 | | | |
| DK 348 K | | | | 348 | | | |
| DK 349 K | | | | 349 | | | |
| FI 359 K | | | | 359 | | | |
| PL 369 K | | | | 369 | | | |
| AT 378 K | | | | 378 | | | |
| AT 379 K | | | | 379 | | | |
| | | | | 070 | | | |
| Z17 Push button 2 setup | | | | | | | |
| See PB2 order form or contact Kamstrup | | | | | - | | |
| No PB2 setup | | | | | 000 | | |
| Z18 1107 configuration | | | | | | | |
| See 1107 order form or contact Kamstrup | | | | | | - | |
| Disabled | | | | | | 000 | |
| Mode A and C, UD | | | | | | 001 | |
| Mode A and C, UD2 | | | | | | 002 | |
| Z20 Calendar setup | | | | | | | |
| See Calendar setup order form or contact Kamstrup | | | | | | | |
| ooo oalonaar sotup ordor form or contact Namistrup | | | | | | | |

| | | 701 | Z22 | Z23 | Z24 | Z25 |
|-----------------|------------------------------|-----|------------|-------------|-------------|-----|
| | | Z21 | LZZ | <i>L</i> 23 | <i>L</i> 24 | 225 |
| Z21 Transforme | erratio | | | | | |
| 5 A/5 A | 1 A/1 A | 001 | | | | |
| 10 A/5 A | 2 A/1 A | 002 | | | | |
| 15 A/5 A | 3 A/1 A | 003 | | | | |
| 20 A/5 A | 4 A/1 A | 004 | | | | |
| 50 A/5 A | 10 A/1 A | 010 | | | | |
| 75 A/5 A | 15 A/1 A | 015 | | | | |
| 100 A/5 A | 20 A/1 A | 020 | | | | |
| 120 A/5 A | 24 A/1 A | 024 | | | | |
| 150 A/5 A | 30 A/1 A | 030 | | | | |
| 160 A/5 A | 32 A/1 A | 032 | | | | |
| 200 A/5 A | 40 A/1 A | 040 | | | | |
| 300 A/5 A | 60 A/1 A | 060 | | | | |
| 500 A/5 A | 100 A/1 A | 100 | | | | |
| 1000 A/5 A | 200 A/1 A | 200 | | | | |
| 1500 A/5 A | 300 A/1 A | 300 | | | | |
| 2 000 A/5 A | 400 A/1 A | 400 | | | | |
| 3 000 A/5 A | 600 A/1 A | 600 | | | | |
| Z22 Transform | er ratio (unlocked / locked) | | | | | |
| Unlocked | | | 1 | | | |
| Locked | | | 2 | | | |
| Z23 Load profil | e, based on | | | | | |
| Primary energy | | | | 1 | | |
| Secondary ener | ду | | | 2 | | |
| Z24 Pulse outp | ut (module) | | | | | |
| Based on secon | idary energy | | | | 0 | |
| Based on prima | ry energy | | | | 1 | |
| Z25 Debitlogge | r 2 interval | | | | | |
| Daily | | | | | | 1 |
| Weekly | | | | | | 2 |
| Monthly | | | | | | 3 |

Installation


Connect the meter in accordance with the installation diagram on the meter's type label.

Depending on the configuration, a fixed value will be displayed, or the display will change automatically between selected indications every 10 seconds.

It is possible to change the display reading manually by activating the left push button on the meter. The available readings will depend on the meter's configuration.

Connection diagrams

The valid connection diagram appears from the type label on the front of the meter.

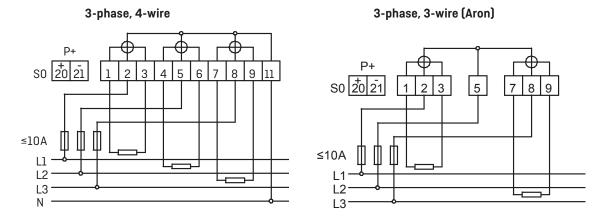

Safety and installation guidelines

The meter shall only to be used for measuring electrical energy and shall operate within the specified values only.

The meter must be switched off when working on it. It can be highly dangerous to touch connected meter parts.

Current local standards, guidelines, regulations and instructions must be observed. Only authorized personnel are permitted to install electricity meters.


Meters for direct connection must be protected against short circuit by a backup fuse in accordance with the maximum current stated on the meter.


The relevant backup fuse must therefore be removed and kept in a place where it cannot be inserted by unauthorized personnel.


The meter constant LED flashes proportionally to the consumed active energy.

Only authorized personnel must break the utility sealing.

Dimensions



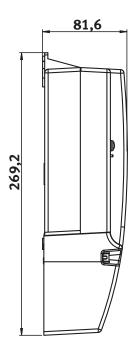

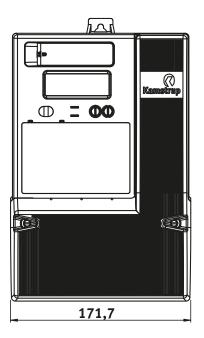

Accessories

| Modules | |
|---|-------------|
| S0 supply module | 68 50 001 |
| IP101i, TCP/IP-module* | 68 50 040 |
| GSM8i 2G* | 6819x0xxxxx |
| GSM8i 2G m/ 2x5A Load Control* | 6819x5xxxxx |
| GSM8i 2G m/ RS-485 add-on* | 6819x6xxxxx |
| OMNICON GSM** | 681Axxxxxxx |
| 5A Load control module | 68 50 058 |
| M-Bus module, secondary addressing* | 68 50 068 |
| 2 x 5A load control modules | 68 50 069 |
| RS485-module, multi drop* | 68 50 072 |
| Data-/pulse module, dual pulse, 9600 | 68 50 075 |
| Tariff control, 4-tariff, 230 V input, current loop | 68 50 076 |
| Tariff control, 4-tariff, 230 V input | 68 50 078 |
| OMNICON MUC-module** | 68 50 079 |
| Software | |
| Configurations SW, METERTOOL | 68 99 580 |
| Various | |
| Standard meter cover | 59 60 370 |
| Long meter cover, 60mm | 59 60 316 |
| Optical reading head with USB plug | 66 99 099 |
| Optical reading head with 9-pole D-sub connector | 66 99 102 |
| METERTOOL kit for CT ratio programming | 68 30 017 |

Kamstrup A/S

Industrivej 28, Stilling DK-8660 Skanderborg T: +45 89 93 10 00 F: +45 89 93 10 01 info@kamstrup.dk kamstrup.com

^{*} for non-Kamstrup systems only

^{**} for OMNIA system only